

## spirax sarco

TI-P006-01

CH Issue 11

# DP143, DP143G and DP143H Pilot Operated

### **Pressure Reducing Valves with Cast Steel Bodies**

#### **Description**

The DP143, DP143G and DP143H pilot operated pressure reducing valves have been manufactured using cast steel.

#### Available types

**DP143** Suitable for steam applications

DP143G Is a soft seal version available for compressed air and inert industrial gases. Note: It is not recommended for oxygen service.

**DP143H** Is a high temperature version for use up to 350°C.


#### Sizes and pipe connections

DN15LC - Low Capacity version, DN15, DN20, DN25, DN32, DN40, DN50 and DN80.

Standard flanges: EN 1092 PN25 and PN40, BS 10 Table 'J' and ANSI 300.

Available on request: ANSI 150 and JIS 20.

#### Pressure / temperature limits

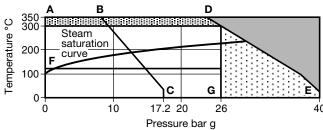

The product **must not** be used in this region.

Due to the material strength of the main diaphragm chamber the product **must not** be used in this region.

Use the high temperature DP143H version in this region.

A-D-E Flanged EN 1092 PN40, ANSI 300 and BS 10 Table J.

A-B-C Flanged ANSI 150.

F-G DP143G limited to 120°C @ 26 bar g.

**Note:** Two colour coded pressure adjustment springs are available for the following downstream pressure ranges:

Red 0.2 bar g to 17 bar g Grey 16.0 bar g to 24 bar g

Body design conditions PN40						
Maximum design pressure	A-B-C	17.2 bar g @ 40°C				
Waximum design pressure	A-D-E	Limited to 26 bar g				
Maximum design temperature		350°C @ 24 bar g				
Minimum design temperature		0°C				
Maximum upstream pressure	A-D-E	26 bar g				
for saturated steam service	A-B-C	14 bar g				
	DP143	300°C @ 26 bar g				
Maximum operating temperature	DP143G	120°C @ 26 bar g				
	DP143H	350°C @ 24 bar g				
Minimum operating temperature		0°C				
Note: For lower operating temperature	eratures co	onsult Spirax Sarco				
Maximum differential pressure	A-D-E	26 bar				
Waximum ameremai pressure	A-B-C	14 bar				
Designed for a maximum cold hydraulic test pressure of 60 bar g						
Note: With internals fitted, test pressure must not exceed 40 bar g						


#### Ky values

The  $K_V$  maximum values shown below are **full** capacities and should be used for safety valve sizing purposes only.


DN15LC	DN15	DN20	DN25	DN32	DN40	DN50	DN80
1.0	2.8	5.5	8.1	12.0	17.0	28.0	64.0


For conversion:  $C_V$  (UK) =  $K_V \times 0.963$   $C_V$  (US) =  $K_V \times 1.156$ 

**Note:** Where the internal balance pipe is used the valve capacity will be reduced.

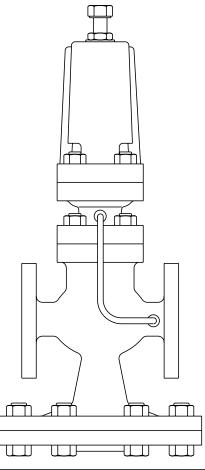


Ма	terials							
No.	Part		Material					
1	Adjustment	screw	Steel	BS 3692 Gr. 8.8				
2	Adjustment	lock-nut	Steel BS 3692 Gr. 8					
3	Washer		Stainless steel BS 1449 304 S16					
4	Spring hous	sing	Cast steel DIN 17245 GS C25					
5	Top spring	plate	Stainless steel	BS 970 220 Mo7				
6	Pressure ac	ljustment spring	Stainless steel	BS 2056 302 S25				
7	Bottom spr	ing plate	Steel	BS 970 220 Mo7				
8	Spring	Securing nuts	Steel	BS 3692 Gr. 8				
Ū	housing	Securing studs	Steel	BS 4439 Gr. 8.8				
			DN15 to DN80 M10 x 30 mm					
9	Pilot diaphr			BS 1449 316 S31				
10	Pilot valve h	nousing	Steel DN15 to DN50 DN80	DIN 17245 GS C25 GP 240 GH+N				
11	Pilot valve p	olunger	Stainless steel	BS 970 431 S29				
12	Spring hous	sing cover	Stainless steel	BS 1449 304 S12				
13	Pilot valve a	and seat unit		BS 970 431 S29 nless steel/nitrile				
14	Internal stra	ainer	Stainless steel	BS 1449 304 S16				
15	Body gaske	et	Stainless steel exfoliated grap					
16	Main valve r	eturn spring	Stainless steel BS 2056 302 S16					
17	Main valve		Stainless steel BS 970 431 S29 DP143G is stainless steel/nitrile					
18	Main valve	seat		BS 970 431 S29 nless steel/nitrile				
19	Balance pip	e assembly	Stainless steel	BS 3605 304 S14				
20	Main valve	body	Cast steel DI	N 172 45 GS C25				
21	Pilot valve	Securing nuts	Steel	BS 3692 Gr. 8				
	housing	Securing studs	Steel DN15 and DN2	BS 4439 Gr. 8.8 0 M10 x 25 mm				
			DN25 to DN50 M12 x 30					
			DN80	M12 x 40 mm				
22	Main diaphi	ragm chamber	Cast steel D	IN 17245 GS C25				
23	Main	Securing nuts	Steel	BS 3692 Gr. 8				
	diaphragm	Securing bolts	Steel DN15 and DN2 DN25 and DN3 DN40 and DN5 DN80	2 M12 x 60 mm				
24	Main diaphi	ragms	Stainless steel	BS 1449 316 S31				
25	Main diaphragm plate		Stainless steel BS 970 431 S29					
26	Push rod		Stainless steel BS 970 431 S29					
27	Control pipe	e assembly	Stainless steel BS 3605 304 S14					
28	Plug 1/8" BS	Р	Steel					
29	Pressure pi	pe union	Steel					
30	Lock-nut		Steel	BS 3692 Gr. 8				
45	Body studs		Steel BS 4439 Gr. 8.8					
. •	Body nuts		Steel BS 3692 Gr. 8					
	I I		DN15 to DN80	M12 x 40 mm				
46	Upper main diaphragm		Cast steel D	IN 17425 GS C25				

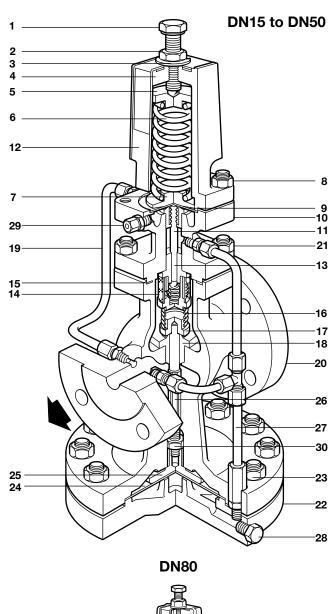


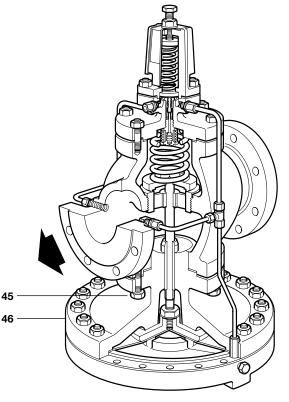

#### Dimensions / weights (approximate) in mm and kg

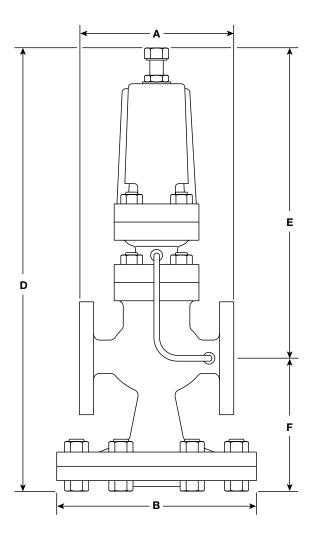

	EN 1092 PN40	ANSI 300	ANSI 150	BS 10 Table J					
Sizes	Α	Α	Α	Α	В	D	E	F	Weight
DN15 LC	130	130	122	130	175	405	277	128	15
DN15	130	130	122	130	175	405	277	128	15
DN20	150	150	142	150	175	405	277	128	16
DN25	160	160	156	164	216	440	288	152	23
DN32	180	183	176	184	216	440	288	152	25
DN40	200	209	200	209	280	490	305	185	40
DN50	230	236	230	243	280	490	305	185	42
DN80	310	319	310	325	350	580	322	258	103

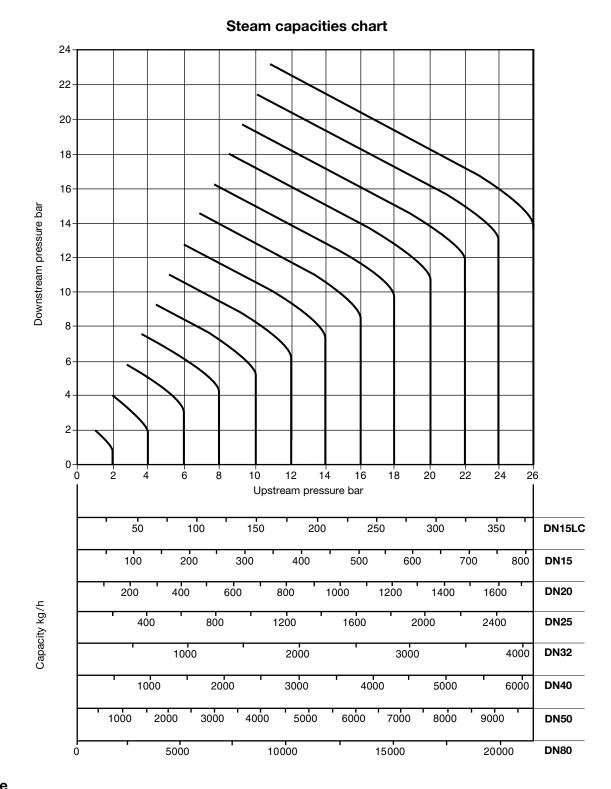

#### **Note**

The capacities quoted above are based on valves fitted with an external pressure sensing pipe. Reliance on the internal balance pipe will mean that capacities may be reduced. In the case of low downstream pressure this reduction could be up to 30% of the valve capacity.

#### How to use the chart


#### Saturated steam

A valve is required to pass 600 kg/h reducing from 6 bar to 4 bar. Find the point at which the curved 6 bar upstream pressure line crosses the horizontal 4 bar downstream pressure line. A perpendicular dropped from this point gives the capacities of all DP sizes under these conditions. A DN32 valve, is the smallest size which will carry the required load.

#### Superheated steam

Because of the higher specific volume of superheated steam a correction factor must be applied to the figure obtained from the chart above. For 55°C of superheat the factor is 0.95 and for 100°C of superheat the factor is 0.9.

Using the example given for saturated steam, the DN32 valve would pass  $740 \times 0.95 = 703 \text{ kg/h}$  if the steam had  $55^{\circ}\text{C}$  of superheat. It is still big enough to pass the required load of 600 kg/h.

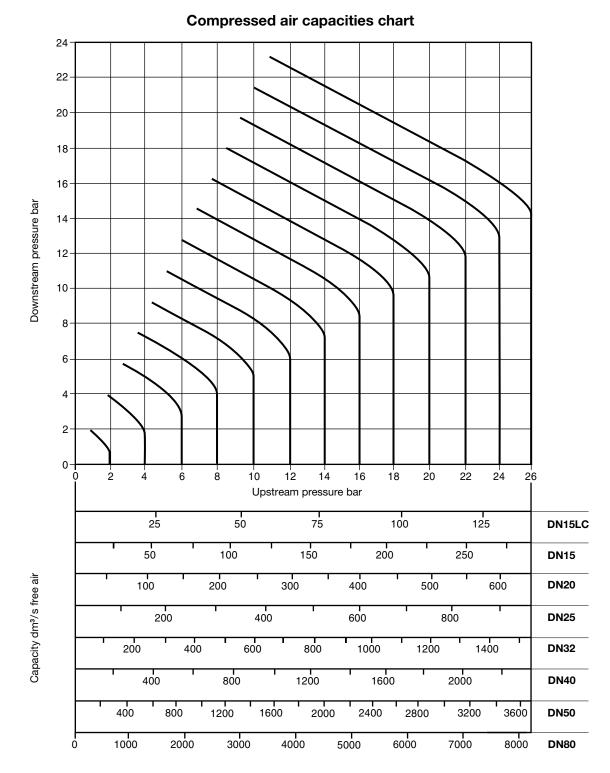

#### How to use the chart

Capacities are given in cubic decimetres of free air per second (dm³/s). The use of the capacity chart can be best explained by an example. Required, a valve to pass 100 dm³/s of free air reducing from 12 bar to 8 bar.

Find the point at which the curved 12 bar upstream pressure line crosses the horizontal 8 bar downstream pressure line. A perpendicular dropped from this point shows that whereas a DN15LC valve will only pass 57 dm³/s and is therefore not large enough, a DN15 valve will pass approximately 120 dm³/s under these conditions and is the correct valve size to choose.

#### Safety information, installation and maintenance

For full details see the Installation and Maintenance Instructions (IM-P006-07) supplied with the product.

#### Installation note:

The valve should be installed in a horizontal pipeline with the direction of flow as indicated by the arrow on the valve body.

#### How to order

**Example:** 1 off Spirax Sarco DN32 DP143 pilot operated pressure reducing valve fitted with a red pressure adjustment spring and having flanged EN 1092 PN25 connections.

#### **Spare parts**

#### Available spares

Available spares					
Maintenance kit					
A stand-by set of spares for general maintenance purpose	es and covers a	ll spares marked*			
* Main diaphragm	(2 off)			Α	
* Pilot diaphragm	(2 off)			В	
Pilot valve seal assembly				С	
* Pilot valve and plunger assembly				D, E	
Main valve assembly				F, H	
* Main valve return spring				G	
Dunana addinata ant ancia a	Red	DP143, DP143G, DP143H	(	0.2 to 17 bar	
Pressure adjustment spring	Grey	DP143, DP143G, DP143H		16 to 24 bar	
Control pipe assembly				K	
Balance pipe assembly				M, N	
* Body gasket	(packet	of 3)		0	
* Set of spring housing securing studs and nuts	(set of	4)		Р	
* Set of pilot valve housing securing studs and nuts	(set of	4)		Q	
	(set of	10)	DN15 and DN20		
Set of diaphragm chamber securing bolts and nuts	(set of 12)		DN25 and DN32	R	
Set of diaphilagin chamber securing boils and huts	(set of	16)	DN40 and DN50	n	
	(set of	20)	DN80		
Set of main body studs and nuts (DN80)	(set of	6)		Т	
Pushrod and main diaphragm plate assembly				V, W, X	

#### How to order spares

Always order spares by using the description given in the column headed 'Available spares' and state the size and type of pressure reducing valve.

**Example:** 1 - Main valve assembly for a Spirax Sarco DN15 DP143 pressure reducing valve.

How to fit. See the Installation and Maintenance Instructions supplied with the pressure reducing valve. Further copies are available on request.

#### Interchangeability of spares

The following table shows how in certain sizes some parts are interchangeable. For example in the line headed 'Main diaphragm' the diaphragm used in the following sizes: DN15LC, DN15 and DN20 is common to these sizes by the letter 'a'. The letter 'b' indicates that sizes DN25 and DN32 use one common diaphragm.


Some parts, particularly pilot and main valve assemblies are specific to particular models e.g. DP143G Interchangeability is therefore restricted to model type for some parts.

† Please note for storage purposes: The spare parts marked † are not the same material as those for the DP163, consequently they may not be compatible for interchangeability.

	**							
Size	DN15LC	DN15	DN20	DN25	DN32	DN40	DN50	DN80
Main diaphragm	а	а	а	b	b	C	С	d
Pilot diaphragm	а	а	а	а	а	а	а	а
Pilot valve seal assembly	а	а	а	а	а	а	а	а
Pilot valve and plunger assembly	а	а	а	а	а	а	а	а
Main valve assembly	а	b	С	d	е	f	g	h
Main valve return spring	а	а	а	b	b	С	С	d
Pressure adjustment spring	а	а	а	а	а	а	а	а
Control pipe assembly	а	а	b	С	d	е	f	g
Balance pipe assembly	а	а	b	С	d	е	f	g
Body gasket	а	а	а	b	b	С	С	d
Set of spring housing securing studs and nuts	а	а	а	а	а	а	а	а
Set of pilot valve housing securing studs and nuts	а	а	а	b	b	С	С	d
Set of diaphragm chamber securing bolts and nuts	а	а	а	b	b	С	С	d
Set of main body studs and nuts	-	_	_	-	_	-	_	а

<sup>\*\*</sup> Not available for the DP143G



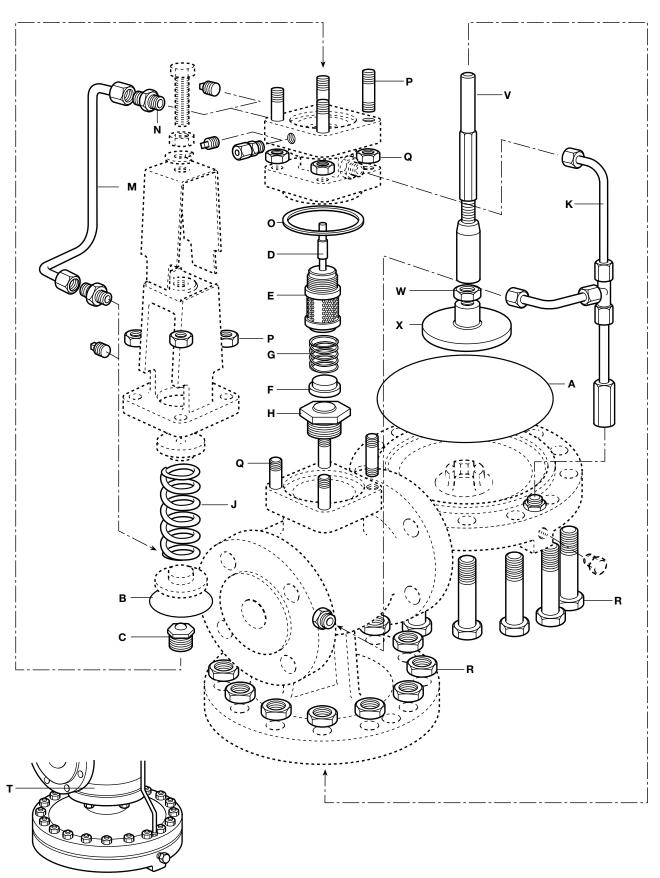

Arrangement of main diaphragm chamber DN80 size only.